

Appendix C – BB Power Report

**PRELIMINARY ENGINEERING STUDY FOR  
FEASIBILITY OF MODULAR BIO-GASIFIER  
HOT PRODUCER GAS INJECTION INTO  
PULVERIZED COAL FIRED  
FLAT WALL FURNACE**

**FOR:**

**NEXANT INC.**

**AT**

**WESTERN KENTUCKY ENERGY  
REID PLANT  
SEBREE POWER COMPLEX  
SEBREE, KENTUCKY**

**BBP CONTRACT No. 200756  
Original Contract Riley Stoker Corp. B2502**

**Date Issued: 31 May 2001**

PRELIMINARY ENGINEERING STUDY FOR  
FEASIBILITY OF MODULAR BIO-GASIFIER  
HOT PRODUCER GAS INJECTION INTO  
PULVERIZED COAL FIRED  
FLAT WALL FURNACE


FOR  
NEXANT INC.  
AT

WESTERN KENTUCKY ENERGY  
REID PLANT  
SEBREE POWER COMPLEX  
SEBREE, KENTUCKY


BBP CONTRACT NO. 200756  
Original Contract Riley Stoker Corp. B2501

DATE ISSUED: 31 May 2001


Prepared By:

 25 May 01  
Frank Zone, Jr., P.E.  
Sr. Staff Engineer  
Boiler Design

Prepared By:

 P.E.  
Richard J. Dube, P.E.  
Sr. Consultant  
Fuel Burning

Approved By:

 29 May 2001  
Brian Vitalis  
Manager  
Boiler Design

# BABCOCK BORSIG POWER

May 31, 2001

NEXANT, Inc.  
45 Fremont Street, 7<sup>th</sup> Floor  
San Francisco, CA 94105-2210

Attn: Mr. Babul Patel

Subject: Phase 1 Engineering Study for Feasibility of Modular Bio-Gasifier Hot  
Producer Gas Injection into Pulverized Coal Fired Flat Wall Furnace  
At Western Kentucky Energy, Reid Plant  
Sebree Power Complex, Sebree, Kentucky  
NEXANT, Inc. PO #0104-NEX-133  
Original Contract Riley Stoker Corp, B2502  
DB Riley Contract 200756

Dear Babul,

Thank you for using Babcock Borsig Power's engineering services; attached please find three copies of engineering's report that provides NEXANT assistance and recommendations in determining feasible locations, size, and number of penetrations required to flow syn gas into a pressurized type furnace.

As mentioned in today's conversation, once you have reviewed the report, call me a day ahead of time and I will set up a teleconference with engineering (Frank and Dick) to answer any questions that you may have.

Thank you for the opportunity to be of service to you, BBP looks forward to perhaps working with NEXANT on Phase 2 of this project.

Sincerely,

Babcock Borsig Power, Inc.



Elaine K. Strzelewicz  
Job Manager, Field Engineering and Services Department

CC: K. Davis, P. Knight/1, J. Scott/1, E. Vega/1

**Babcock Borsig Power, Inc.**  
**Energy Systems and Services Division**

Mailing Address:

Post Office Box 15040  
Worcester, MA 01615-0040

Shipping Address:

5 Neponset Street  
Worcester, MA 01606

Telephone: (508) 852-7100  
Fax: (508) 852-7548

[www.bbpwr.com](http://www.bbpwr.com)

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

DISTRIBUTION LIST

Nexant, Inc.

K. Davis

R. Dube

P. Knight

T. Martinko

J. Scott


E. Strzelewicz

E. Vega

B. Vitalis

F. Zone

Extra (3 Copies)

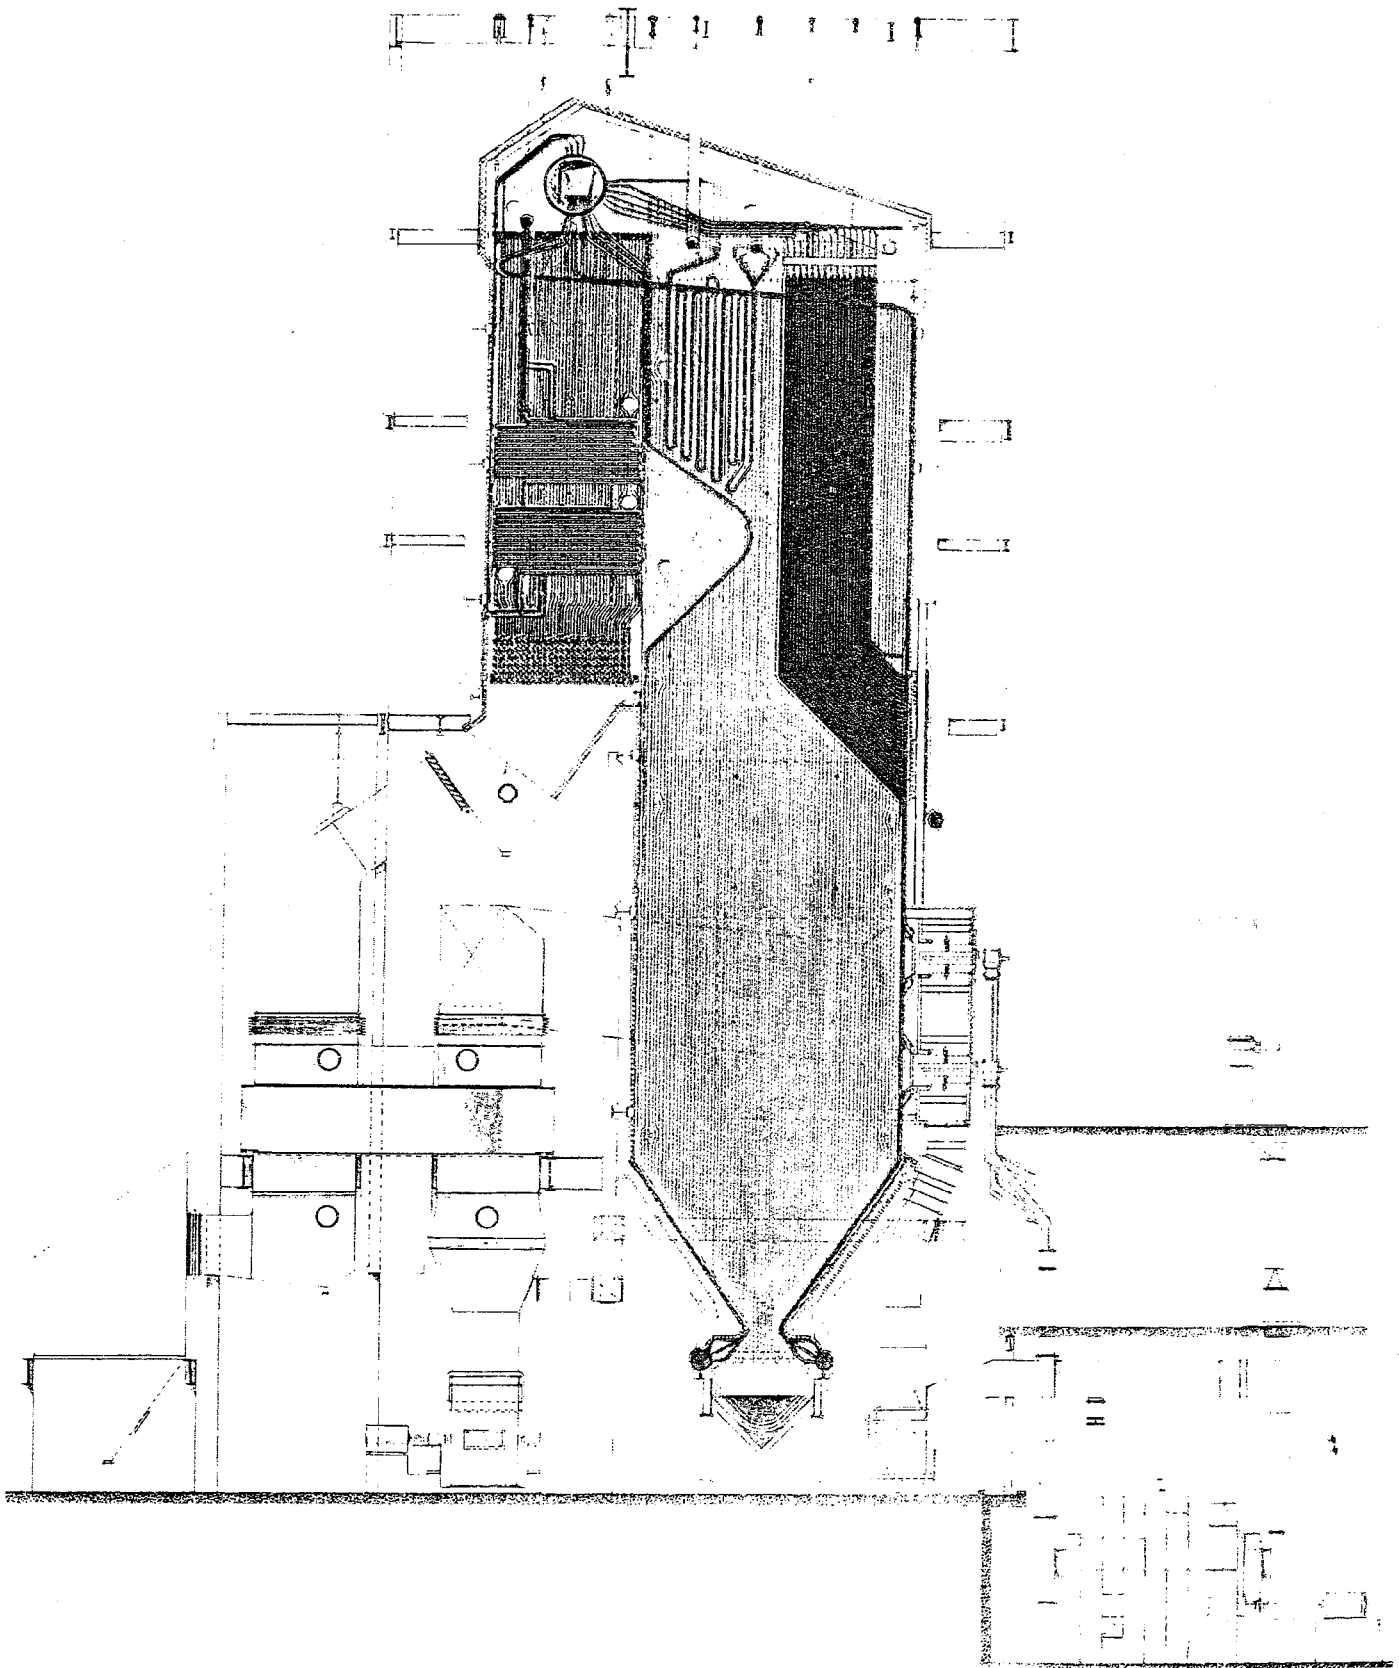

**BIG RIVERS RURAL ELECTRIC COOPERATIVE CORP.  
SEBREE, KENTUCKY**

690,000 lbs/hr—1475 psig design—1300 psig operating—955F  
Burns & McDonnell Engineering Co., Consulting Engineers

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

TABLE OF CONTENTS

1.0 INTRODUCTION	1
1.1 Introduction	1
1.2 Background	2
2.0 EXECUTIVE SUMMARY	3
2.1 Objective	3
2.2 Findings and Conclusions	4
2.3 Recommendations	5
3.0 DISCUSSION	6
3.1 Description of Bio-Gasifier Process	6
3.2 Boiler Performance	12
3.3 Syn Gas Penetration Size Requirements	15
3.4 Boiler Syn Gas Penetration Location	18
3.5 Syn Gas Pressure Requirements	20
3.6 Preliminary Recommendations on Required Stiffening/Strengthening at the Boiler Penetrations	21
4.0 APPENDICES	22
4.1 Original Boiler Performance	22
4.2 Communications	23

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

LIST OF TABLES

1. Gasifier Process Streams
2. Boiler Performance

LIST OF FIGURES

1. Poultry Litter Gasification Process Schematic
2. Syn Gas Penetration Sizing Nomogram
3. Syn Gas Penetration Location



**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

## 1.0 INTRODUCTION AND BACKGROUND

### 1.1 Introduction

NEXANT, Inc. and its partners, Western Kentucky Energy and Primenergy, are working with DOE-NETL to develop a biomass cofiring project at the Western Kentucky Energy Reid Plant located near Henderson, Kentucky. The cofiring project is a proposal for the installation of modular bio-gasifier(s) adjacent to the existing boiler and injecting the hot producer gas from the gasifier into the boiler. As part of phase 1, Nexant is seeking assistance in modeling the expected boiler operation post gasifier(s) installation. The specific tasks for BBP (subcontractor scope of work) as a part of phase 1 are as follows:

- Determine feasible locations for boiler penetration(s) to minimize the impact on existing boiler equipment
- Size the penetrations
- Determine pressure requirements at the penetrations
- Provide preliminary recommendations on required stiffening/strengthening at the boiler penetrations.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

## 1.2 Background

The Western Kentucky Energy Reid Plant was designed by Riley Stoker Corporation under contract B-2502 (1962). It consists of one steam generating unit at a maximum continuous rating of 690,000 Lb/hr steam flow, 1300 psig outlet steam pressure, 955 °F outlet steam temperature, 440 °F feedwater temperature entering the economizer, while firing West Kentucky Bituminous coal. The boiler has two (2) Riley ball tube mills, eight (8) Riley type 60 flare burners, and one (1) Ljungstrom 25VIx48 air heater.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

**2.0 EXECUTIVE SUMMARY**

**2.1 Objectives**

The objectives of this preliminary engineering study are as follows:

- Determine the size and number of penetrations required to flow ~~syn~~<sup>producer</sup> gas into the furnace.
- Determine feasible locations for the penetrations in order to minimize the impact on existing boiler equipment.
- Determine the ~~syn~~<sup>producer</sup> gas pressure requirements at the penetrations.
- Provide preliminary recommendations on required stiffening/strengthening at the penetrations.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

2.2 Findings and Conclusions

- The overfire combustion chamber stream 11 <sup>process</sup> syn gas flow is 73,837 ACFM at 2,400 °F. The selected velocity is 150 ft/sec and total required cross sectional flow area is 8.204 ft<sup>2</sup>. The conclusion is that 4 penetrations of 19.5 inch inside diameter will satisfy the total flow cross sectional area requirement.
- The most feasible locations for the penetrations are on the lower sidewalls of the furnace.
- The syn gas pressure requirement for stream 11 at the penetration is 10.0 i.w.c.
- The furnace expansion at the location of the 4 proposed penetrations from ambient rest position to MCR condition is 4.25 inch downward at the bottom and 0.75 inch towards the side and front. Strengthening or stiffening for these expansions is not done, rather expansion joints are usually provided.
- The Nexant, Inc., proposed 38" OD syn gas transport piping (4 pipes) with an estimated 268 °F outside surface temperature will require personnel protection to meet OSHA requirements and appropriate plant cooling/ventilation.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

2.3 Recommendations

- The penetration velocity of 150 ft/sec , suggested by Nexant, Inc., should be increased to provide for smaller inside diameter and smaller outside diameter. This of course will require increased syn gas pressure at the penetration.
- The recommended velocity is 300 ft/sec and the inside diameter is 14 inch, 4 penetrations. The required pressure at the penetration is 12.6 i.w.c.
- The bio-gasifier stream 11 piping from the overfire combustion chamber to the furnace penetration must have expansion joints to accommodate the thermal movements of the furnace and to isolate piping loads from the furnace. The piping must have outside insulation to meet OSHA requirement of 130 °F surface temperature.
- The selection of the penetration location on the lower sidewalls of the furnace was based upon space availability and practicality. A CFD flow model study should be done to investigate the flow of syn gas into the furnace during coal firing.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

### 3.0 DISCUSSION

#### 3.1 Description of Bio-Gasifier Process

The bio-gasifier process utilizes poultry litter as primary fuel in conjunction with air and pilot gas to produce syn gas and residual ash. The poultry litter is delivered (via truck), stored in fuel storage house, unloaded to fuel silos, discharged to sizing screen (with hammermill recycle back to sizing screen, sent to metering bin, thence to bucket elevator, through to rotary valve, then to infeed conveyor, then to gasifier. A fan supplies underfire air to the gasifier and bottom ash is removed from the gasifier via conveyor to an ash silo. Gasifier product gas is water quenched prior to transport to a ceramic fiber filter process. Ash is removed from the ceramic fiber filter bucket via bottom valves and sent to the ash conveyor of the gasifier. The product gas then flows via an induced draft fan to an overfire combustion chamber. Overfire air, via a forced draft fan, and pilot gas are fed to the combustion chamber to produce syn gas. The syn gas then flows to a syn gas burner chamber for combustion with pilot gas and air (via forced draft fan). The final product gas is intended for use in the boiler.

A schematic diagram of the poultry litter gasification process is shown in Figure 1.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

The three streams considered to be of interest for utilization in the boiler are stream 8 (1381.8°F), stream 11 (2400°F), and stream 14 (2330.2°F) and the stream component flow rates are listed in Table 1.

Stream 8 is a gas mixture of carbon monoxide, carbon dioxide, hydrogen, water vapor, nitrogen, and sulfur dioxide. The mass flow rate is 41,505 Lb/hr and the volumetric flow rate is 37701 ACFM at 1381.8°F. Not included in the flow stream are amines (small amount) as a result of the gasification process. The sensible heat of stream 8 is 429 Btu/Lb.

Stream 11 is a gaseous mixture of carbon monoxide, carbon dioxide, hydrogen, water vapor, and nitrogen. The mass flow rate is 57,440 Lb/hr and the volumetric flow rate is 74,129 ACFM at 2400°F. The sensible heat of stream 11 is 760 Btu/Lb.

Stream 14 is a gaseous mixture of carbon dioxide, water vapor, nitrogen, and oxygen. The mass flow rate is 82,588 Lb/hr and the volumetric flow rate is 100,000 ACFM at 2330°F. The sensible heat of stream 14 is 693 Btu/Lb. Stream 14 has no chemical heat (i.e., HHV=0)

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

Stream 8 and stream 11 have chemical heating value of up to 100 Btu/Lb (HHV). There is no chemical heating value for stream 14 because the gaseous mixture is composed of oxygen and inerts.

The original background information from Nexant, Inc., noted that the syn gas for boiler utilization would have a heating value of 100 Btu/Scf and sensible heat value at 1000° F stream temperature as injected into the boilers.

The syn gas of stream 8 has amines (nitrosamines, etc.) and when injected into the furnace may produce NO<sub>x</sub> because of the bound nitrogen in this chemical species group.

The syn gas of stream 14 is basically inert and therefore has no chemical heating value. Elimination of the final bio gas process combustion chamber will reduce the size, cost, etc., of the process and therefore this stream would not be available. In essence, this stream would be similar to flue gas recirculation.

Stream 11 is the main choice of Nexant, Inc. and is a better choice than stream 14 because that the volumetric flow rate of stream 11 is much less (approximately 26 %) than the volumetric flow rate of stream 14.



**BABCOCK BORSIG POWER, INC.**


Nexant Inc.

WKE Reid Plant

BBP Contract 200756

However, the temperature of stream 11 is  $70^{\circ}\text{F}$  greater than stream 14 (i.e.  $2400^{\circ}\text{F} - 2330^{\circ}\text{F} = 70^{\circ}\text{F}$ ) and higher temperatures place more limitations on material selection (metals and refractories/insulation) than do lower temperature flowing media.

Actually streams 11 and 14 are much higher in temperature than normally encountered in conventional boiler practice for external boilers connections. Conventionally external boiler convections seldom exceed  $1000^{\circ}\text{F}$ . Such high temperatures present materials, insulation, and expansion difficulties.

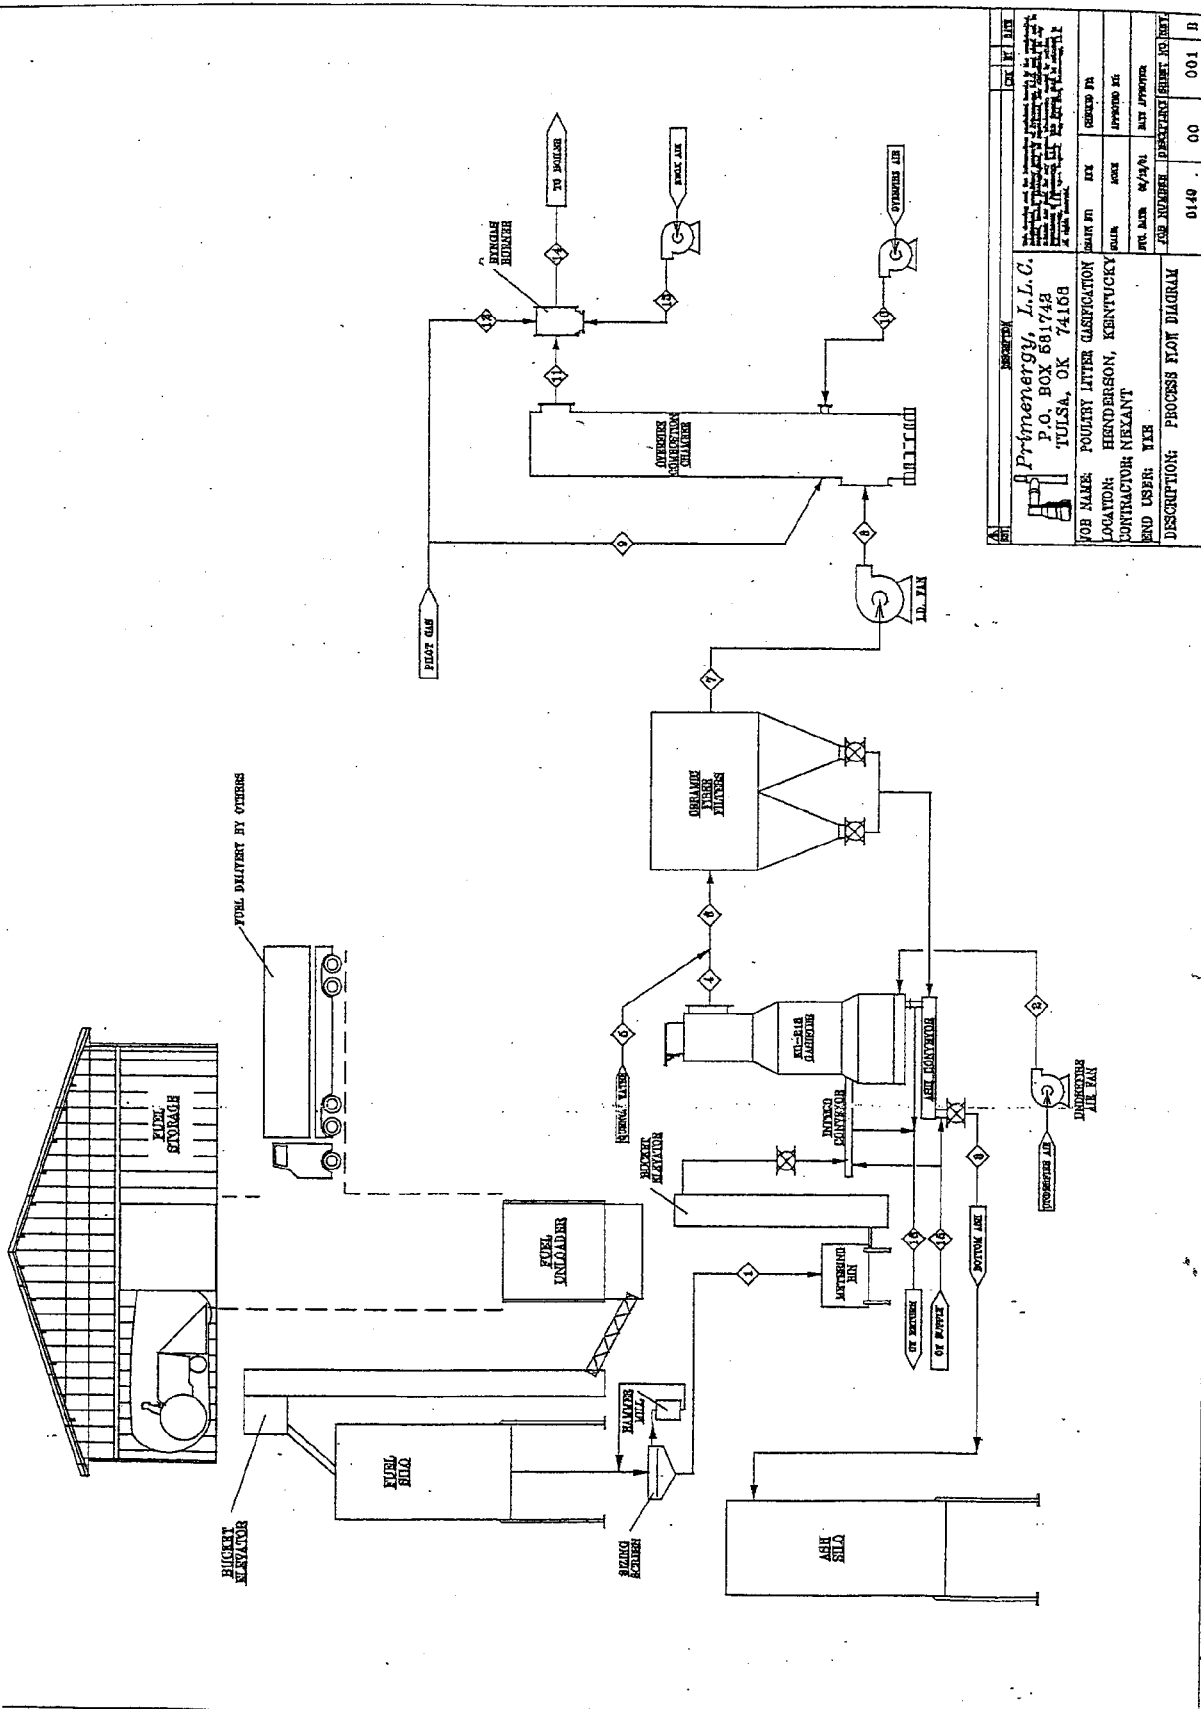

**Figure 1**  
**Poultry Litter Gasification**  
**Process Schematic**

Stream ID Stream	1	2	3	4	8	9	10	11	12	13	14
Name	GASIFIER	GASIFIER	GASIFIER	GASIFIER	ID	PILOT	OVERFIRE	OVERFIRE	PILOT	REOX	COMB
	FEED	COMB AIR	BOTTOM ASH	SYN GAS	FAN EXHAUST	GAS	COMB AIR	SYN GAS	GAS	COMB AIR	PROD TO BOILER

Pressure, "w.c.-g, or psig	20.0	3.0	8.0	13.0	7.0	(30.0)	13.0	(30.0)	13.0	6.0
Temperature, °F	77.00	80.0	1,381.8	80.0	2,400.0	80.0	28.7	16.0	16.0	28.0
Molecular Weight (Lb/Lbmole)	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h	Lb/h
Component	Formula	MW								
Carbon	C	12.01	4,617.30	300.0	466.9					
Hydrogen	H	1.01	526.60							
Nitrogen	N	14.01	463.00							
Oxygen	O	16	3,416.10							
Sulfur	S	32.06	82.90							
Chlorine	Cl	35.45								
Fuel Gas	CH4	16.04				23.3			23.3	
Carbon Monoxide	CO	28.01		3,819.3	3,819.3			633.3		
Carbon Dioxide	CO2	44.01		9,206.7	9,206.7			14,276.2		15,335.0
Hydrogen	H2	2.02		421.0	421.0			200.4		
Water (v)	H2O (v)	18.02	267.1	5,411.6	6,575.7		157.0	8,756.2		10,843.7
Nitrogen	N2	28.01	20,853.3	21,316.3	21,316.3		12,257.5	33,573.7		52,672.6
Oxygen	O2	32	6,312.8				3,710.7			3,737.0
Sulfur Dioxide	SO2	64.06		165.7	165.7					
Hydrogen Chloride	HCl	36.46								
Ash	SiO2	60.08	3,494.00	3,960.9						
Lime	CaCO3	100.09								
Water (l)	H2O (l)	18.02	4,200.00							
TOTAL			16,800.0	4,427.8	41,504.6	23.3	16,125.1	57,439.8	23.3	25,125.3
AVAILABLE ENERGY VALUE (LHV-Hv), Btu/lb			4,051.50		953.9	928.7	21,502.0	229.0	21,502.0	
AVAILABLE ENERGY, MMBtu/h			68.10		38.5	38.5	0.5	13.2	0.5	
FLOW RATE, scfm (gpm)			6,049.9		10,242.9	10,644.2	9.2	13,478.1	9.2	5,541.0
FLOW RATE, acfm			6,282.6		39,592.7	37,701.1	9.5	74,129.3	8.1	5,754.1
										100,030.5

Table 1  
Gasifier Process Streams

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

### 3.2 Boiler Performance

Boiler heat and mass balance calculations were performed for original boiler performance conditions at 100 % load, stream 8 and coal at 100 % load, stream 11 and coal at 100 % load, and stream 14 and coal at 100 % load. The original boiler performance sheet is shown in the Appendix. The boiler conditions at 100 % load (MCR) are 640,000 Lb/hr steam flow, 955 °F outlet steam temperature, 1300 psig outlet steam pressure, 440 °F feedwater temperature, 343 °F stack temperature (undiluted), ambient air temperature 80 °F, and 22 % excess air (total). The boiler efficiencies are 86.55 % (original, coal only), 85.77 % (stream 8 and coal), 85.43 % (stream 11 and coal), and 85.82 % (stream 14 and coal).

The split of heat input by fuel is as follows: 100 % coal (original), 91% coal/9 % Syn Gas (coal and stream 8), 94% coal/6 % Syn Gas (coal and stream 11), and 94 % coal/6 % Syn Gas (coal and stream 14). The coal flows for comparison are 71,316 Lb/hr (original) 64,932 Lb/hr (stream 8), 67,218 Lb/hr (stream 11), and 66,943 Lb/hr (stream 14).

The EPRS heat release and the volumetric heat release are virtually the same for all cases. The furnace exit gas temperature (FEGT) is 1,870 °F (original), 1,861 °F (stream 8), 1,850 °F (stream 11), and

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

1,846 °F (stream 14) for a decrease of 9 °F, 20 °F. and 24 °F for stream 8, 11, and 14, respectively. The change in furnace flue gas flow relative to original furnace flue gas flow is -0.2 % (stream 8), +2.6 % (stream 11), and +4.0 % (stream 14). These small changes in FEGT and furnace flue gas flows indicate the back pass (i.e. rear convection pass) of the boiler will perform similar to the original case and result in a similar stack temperature and therefore, yield the predicated boiler efficiencies. Therefore the boiler performance and efficiency is not expected to change for all four cases studied.

The furnace is a pressurized type and the pressure is +9.1 i.w.c. At 100 % MCR as per original contract design. The expected syn gas port pressure at the port exit plane of furnace entry is the sum of furnace pressure and one velocity pressure head of flowing syn gas as shown in Table 2 (i.e., 10.3 i.w.c. stream 8, 9.95 i.w.c. stream 11, and 10.0 i.w.c. stream 14). The calculated ACFM's of syn gas are 37,553 stream 8, 73,837 stream 11, and 99,635 stream 14. For the case of syn gas port velocity of 150 ft/sec (9,000 ft/min) and the selection of 4 ports, the syn gas port inside diameters are 14 inch (stream 8), 19.5 inch (stream 11), and 22.5 inch (stream 14).

Item		Original	Stream 8	Stream 11	Stream 14
Boiler Load	%	100	100	100	100
Steam Flow	Lb/hr	690,000	690,000	690,000	690,000
Outlet Steam Temperature	°F	955	955	955	955
Outlet Steam Pressure	PSIG	1,300	1,300	1,300	1,300
FW Temperature	°F	440	440	440	440
Stack Temperature (Undiluted)	°F	343	343	343	343
Stack Temperature (Diluted)	°F	328	328	328	328
Ambient Air (Reference)	°F	80	80	80	80
Boiler Efficiency (With margin)	%	86.55	85.77	85.43	85.82
Excess Air	%	22	22	22	22
Coal Flow	Lb/hr	71,316	64,932	67,218	66,943
Syn Gas Flow	Lb/hr	0	41,505	57,440	82,588
Coal HHV	Btu/Ft	11,600	11,600	11,600	11,600
Syn Gas HHV	Btu/Ft <sup>3</sup>	---	100	18	0
Syn Gas Sensible Heat	Btu/Lb	---	429.61	759.96	693.4
Syn Gas Temperature	°F	---	1381.8	2400	2330.2
Heat Input By Coal	%	100	91.048	94.253	93.868
Heat Input by Syn Gas	%	---	8.952	5.747	6.132
EPRS Hr	Btu/hr Ft <sup>2</sup>	68,427	67,914	67,918	67,805
Vol Hr	Btu/hr Ft <sup>3</sup>	14,517	14,647	14,705	14,437
Total Furnace Flue Gas	Lb/hr	810,244	808,729	831,546	843,148
FEGT	°F	1,870	1,861	1,850	1,846
Δ FEGT	°F	---	-9	-20	-24
Δ Furnace Flue Gas	%	---	-0.2	+2.6	+4.0
Furnace Pressure	i.w.c.	9.05	9.05	9.05	9.05
Syn Gas Pressure @ Port	i.w.c.	---	10.3	9.95	10
Total Syn Gas Flow	ACFM	---	37,553	73,837	99,635
Syn Gas Port Velocity	Ft/sec	---	150	150	150
No of Syn Gas Ports	---	---	4	4	4
Syn Gas Port Inside Diameter	Ft	---	1.152	1.616	1.88
Syn Gas Port Inside Diameter	In	---	14	19.5	22.5

Table 2  
Boiler Performance

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

### 3.3 Syn Gas Penetration Size Requirements

The syn gas penetration size requirements are port size (inside diameter and outside diameter) and the number of ports for a total flow cross sectional area to satisfy the volumetric flow rate at specified temperatures at an assumed port velocity (i.e. inside diameter flowing velocity). A syn gas penetration sizing nomogram is shown in Figure 2. The entering arguments are flow ACFM, variable velocity (ft/sec), total flow area (ft<sup>2</sup>), number of penetrations, and the result is penetration inside diameter.

The specific case of interest for Nexant, Inc., is stream 11 flowing 73,837 ACFM at 150 ft/sec and 2,400 °F. This results in a total penetration inside cross sectional area of 8.204 ft<sup>2</sup> and with 4 penetrations, the inside cross sectional area of each penetration is 2.051 ft<sup>2</sup> which converts to an inside diameter of 1.62 ft (i.e. 19.5 inch). However, at 300 ft/sec the inside diameter is 14 inch, which is less than 19.5 inch.

The outside diameter is determined by the thickness of the outside shell (pipe or tube), inside refractory lining, inside high temperature insulation, and outside low temperature insulation. At the 100 % load condition (MCR), the drum pressure is 1,366 psig and the drum saturation is 585 °F and the furnace wall tubes are slightly less than 585 °F on the insulated side. It is good boiler —→

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756


<sup>to</sup>  
the tube/tube wall fin combination and selected metal attachment to the tube/tube wall fin for reasons of thermal expansion stress. Also it is BBP practice in design to meet all OSHA requirements of 130°F (maximum surface temperature) for pipes/tubes accessible to personnel. The method for estimating the heat loss per ft of pipe/tube length is to estimate inside film convective heat transfer coefficient, outside combined radiation and natural convection heat transfer coefficients, select insulating and refractory material thickness and internal conductivity, and perform the calculation for a series of concentric annuli with hot gas flowing on the inside and 80 °F ambient air on the outside.

BBP has performed these calculations and is basically in agreement with the method used by Nexant, Inc., i.e., a good first approximation to the overall pipe outside diameter is 38 inch for the 19.5 inch ID of stream 11 flowing 73,837 ACFM at 150 ft/sec at 2,400 °F.

For the 38 inch outside diameter Nexant, Inc. reports an outside surface temperature of 268 °F which exceeds OSHA requirements of 130 °F. If this design is to be used, special consideration to personnel protection and appropriate plant ventilation/cooling would be needed.



Nexant Inc.  
WKE Reid Plant  
BBP Contract 200756

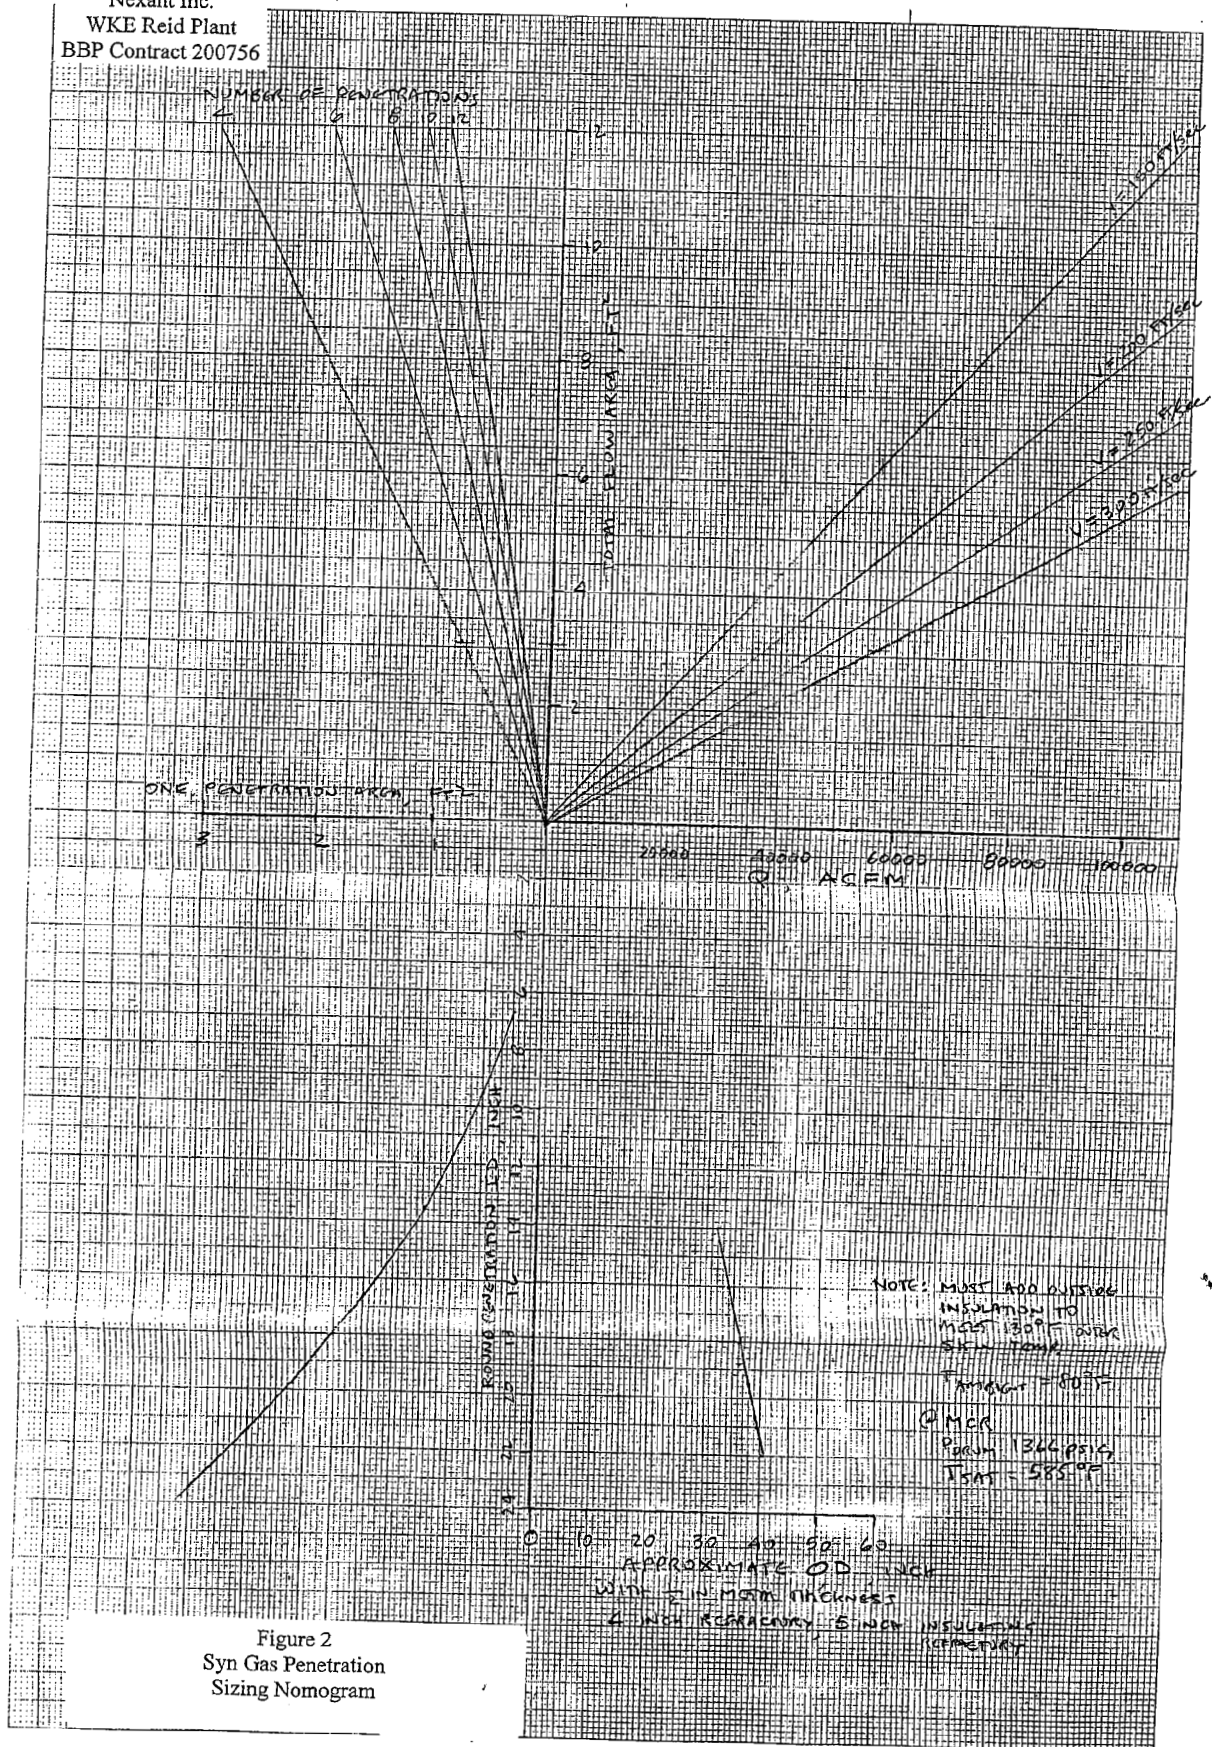

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

### 3.4 Boiler Syn Gas Penetration Location

A boiler side elevation view is shown in the front of this report and should be referred to during this description of the penetration(s) locations. The rear convection pass of the boiler is located under the drum and above the air heater. The forced draft fan is located at ground level underneath the air heater. The Riley ball tube mills (2), pulverized coal transport pipes, coal silo(s), and raw coal transport pipes are located on the front side of the boiler as are the eight (8) Riley flare burners and windbox. Also located on the front wall above the top of the windbox is the supply header for the four(4) furnace water wall platens. There are two main downcomers , one on each side, from the drum to the bottom furnace water wall headers. These downcomers are 21 ½ inch pipes and the main centerline (vertical) is approximately 6 ft from the rear water wall tube centerline towards the front water wall.

The selected area for location of the penetrations is on the side walls, from elevation 452 ft 6 in to elevation 457 ft 6, and from the furnace side wall center to 7 ½ ft towards the front on each side wall. Therefore, the available area is 5 ft x 10 ft = 50 ft<sup>2</sup> on either side wall to locate 2 penetrations in each area for a total of 4 penetrations at elevation 455 ft. The penetration location is shown in the sketch of Figure 3.

Nexant Inc.  
WKE Reid Plant  
BBP Contract 200

Figure 3  
Syn Gas Penetration Locations

ELEVATION, FT

540

530

520

510

500

490

480

470

460

450

440

REAR WALL

FRONT WALL

DOWNCOMER (2)

FURNACE

WIND PENETRATORS (4)

HOR

TOP of windbox

BRIMS (4)

BRIMS (4)

SYN GAS PENETRATION (2 each s.w.w.)

BOTTOM of WINDBOX

OPERATING FLOOR

Figure 3  
Syn Gas Penetration Location

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

**3.5 Syn Gas Pressure Requirements**

At 100 % load, the furnace design flue gas pressure is +9.05 i.w.c. and the syn gas penetration static pressure at the plane of injection into the furnace is 10.3 i.w.c. (stream 8), 10.0 i.w.c. (stream 11), and 10.0 i.w.c. (stream 14).

Presently, stream 11 is the item of interest by Nexant, Inc., and therefore the static pressure is 10.0 i.w.c. for a syn gas velocity of 150 ft/sec and volumetric flow rate of 73,837 ACFM utilizing a total of four (4) penetrations into the furnace. However, at 300 ft/sec the static pressure is 12.6 i.w.c. at the penetration.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

**3.6 Preliminary Recommendations on Required  
Stiffening/Strengthening at the Boiler Penetrations**

The drum centerline is at elevation 543 ft 6 in and the centerline of the furnace waterwall headers is at elevation 439 ft 0 in. The vertical expansion of the furnace is 5 inch downward at elevation 439 ft 0 in. The expected expansion at elevation 455 ft 0 in elevation is 4¼ inch downward.

The horizontal expansion from the boiler rear wall to the furnace front water wall is 1 1/8 inch. The horizontal expansion to the left and to the right about the centerline of the furnace is ¾ inch at the left side water wall and ¾ inch at the right side water wall. The approximate expansion at the centerline locations of the penetrations on the furnace side water walls are ¾ inch outward and ¾ inch towards front of furnace.

The syn gas piping must have expansion joints to accommodate the boiler/furnace expansions expected at the location of the penetrations. By locating the expansion joints close to the furnace, piping loads are not transferred to furnace walls. Waterwall penetrations would likely be similar to standard boiler openings whereby bent tubes and scallop plates form a rigid structure on the furnace wall.

**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

4.0 APPENDICES

4.1 Original Boiler Performance

Surized Unit

BIG RIVERS RURAL ELECTRIC COOPERATIVE CORP.  
SEBREE, KENTUCKY

PB-8920

Sheet 1 of 2

Predicted performance data - One steam generating unit, 690,000 lbs. of steam per hour maximum continuous capacity; 1300 psig operating pressure; variable feed water; steam temperature 955 F.

Fuel - Coal, West Kentucky Bituminous; Moist. 10.0; V.M. 34.9; F.C. 43.1; Ash 12.0; 11,600 Btu per pound as fired. C 61.6; O 7.2; S 3.2; H 1.3; N 4.7; softening temperature ash 2254 F; grindability 60 Hardgrove.

mcr  
↓

4 Hour Peak  
Top Htr  
Out

1. Pounds of steam per hour act. evap.	172,500	345,000	690,000	760,000	760,000
2. Feed water temperature, F.	320	370	440	450	385
3. K Btu in steam above F. W. temp.	197,078	384,333	724,797	789,815	843,995
4. Temp. of gases leaving furnace, F.	1,560	1,360	1,370	1,900	1,930
5. CO <sub>2</sub> in boiler exit gases	14.0	14.7	14.9	14.9	14.9
6. % excess air in boiler exit gases	30	24	22	22	22
7. Temp. of gases entering economizer, F.	660	725	845	870	890
8. Temp. of economizer exit gases, F.	540	625	755	780	785
9. Temp. of water entering economizer, F.	320	370	440	450	385
10. Temp. of water leaving economizer, F.	361	403	466	476	419
11. Water pressure drop thru economizer, psi	1	3	10	12	12
12. Temp. of air heater exit gases, F. (Uncorrected)	259	284	329	342	347
Temp. of air heater exit gases, F. (Corrected)	243	270	315	328	334
14. Temp. of air entering heater, F.	141	116	80	80	80
15. Temp. of air (ambient), F.	80	80	80	80	80
16. Temp. of air leaving heater, F.	478	526	593	607	607
17. Total steam temperature leaving superheater, F.	894	936	955	955	955
18. Steam pressure drop thru superheater and control, psi	4	17	66	89	80
19. Boiler drum pressure, psig	1,304	1,317	1,366	1,380	1,380
20. Pressure drop thru economizer	0.15	0.45	1.50	1.80	2.05
21. Pressure drop thru superheater	0.20	0.60	2.05	2.45	2.80
22. Pressure drop thru dust collector	0.15	0.65	2.50	3.00	3.45
23. Pressure drop thru steam coil	0.05	0.15	0.55	0.65	0.75
24. Pressure drop thru air heater (gas side)	0.35	1.00	3.00	3.55	4.00
25. Pressure drop thru air heater (air side)	0.25	0.65	2.05	2.45	2.75
26. Pressure drop thru ducts and dampers (Including air measurement)	0.15	0.45	1.55	1.85	2.10
27. Pressure drop thru firing equipment	0.20	0.65	2.30	2.75	3.10
28. Total static pressure at fan (inches w.g.)	1.50	4.60	15.50	18.50	21.00

↑

RILEY STOKER CORPORATION  
WORCESTER, MASSACHUSETTS  
8-29-62 D.G.W.

				4 Hour Peak	Top Htr Out
Pounds of steam per hour act. evap.	172,500	345,000	690,000	760,000	760,000
29. Pounds of fuel per hour	19,030	37,350	71,900	78,620	84,210
30. Pounds of air per hour ent. air heater	239,900	419,100	763,500	831,700	888,600
31. Pounds of air per hour lvg. air heater	200,600	375,700	711,700	778,200	833,600
32. Pounds of air per hour for combustion	211,200	395,500	749,200	819,200	877,500
33. Pounds of gas per hour ent. air heater	228,000	428,400	812,500	888,400	951,600
34. Pounds of gas per hour lvg. air heater	267,300	471,800	864,300	941,900	1,006,600
35. Overall efficiency complete unit	89.3	88.7	86.9	86.6	86.4
36. Heat release in furnace, Btu/cu.ft./hr.	4,400	8,600	16,600	18,200	19,400
37. Heat release in furnace, Btu/sq.ft. E.P.R.S./hour	18,100	35,800	69,900	76,600	82,000
38. Number of burners in operation	8	8	8	8	8

## HEAT BALANCE

39.	Dry flue gas loss at exit	2.85	3.84	5.53	5.80	5.98
40.	Loss due to hydrogen and fuel moisture	4.78	4.92	5.19	5.21	5.22
41.	Loss due to moisture in air	0.07	0.09	0.13	0.14	0.15
42.	Loss due to radiation	1.00	0.50	0.25	0.23	0.23
43.	Loss due unburned combustibles	0.50	0.45	0.50	0.52	0.52
	Manufacturer's margin	1.50	1.50	1.50	1.50	1.50
45.	Total losses	10.70	11.30	13.10	13.40	13.60
46.	Efficiencies of complete unit	89.3	88.7	86.9	86.6	86.4

NOTE: Steam temperature control 760,000#/hr down to 456,000#/hr. (By spray).  
Efficiencies based above air temperature entering air heater.

The unit consists of R-36 + W.W. boiler, H.S. 4245 sq.ft.; plus projected water walls, H.S. 11,690 sq.ft.; Total H.S. 15,935 sq.ft.; economizer, H.S. 5100 sq.ft.; Ljungstrom 25VIX48 air heater, H.S. 82,400 sq.ft.; superheater for 955 F.; 2 Riley Ball Tube Mills, 8 #4A Riley burners; furnace volume 50,250 cu.ft.; Drawing LP-1098. & A & B.

RILEY STOKER CORPORATION  
WORCESTER, MASSACHUSETTS  
8-29-62 D.G.W.



**BABCOCK BORSIG POWER, INC.**

Nexant Inc.

WKE Reid Plant

BBP Contract 200756

4.2 Communications

ELAINE  
STRZELEWICZ  
04/24/2001 03:56 PM



To: Frank Zone/Riley/US@Riley  
cc: Richard Dube/Riley/US@Riley  
Subject: Poultry Litter Gasification - PFD

FYI.

----- Forwarded by Elaine Strzelewicz/Riley/US on 04/24/2001 03:55 PM -----



"Babul Patel" <bpatel@nexant.com> on 04/24/2001 02:58:56 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: Poultry Litter Gasification - PFD

Ellen/ Frank:

Here is the PFD - in MS Word format. The stream numbers correspond to the stream numbers identified in the Excel spread sheet.  
As Frank mentioned in our Telecom, we do not have to inject the gases into the boiler @ 2250 Deg F. After the producer gas is filtered through the Hot Gas Filter and boosted to a pressure of 6" WG by an ID fan, we can directly send to the boiler, if appropriate.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580



- PFD.doc



ELAINE  
STRZELEWICZ  
04/24/2001 03:58 PM



To: Frank Zone/Riley/US@Riley, Richard Dube/Riley/US@Riley  
cc:  
Subject: Western Kentucky Poultry Litter Biomass Gasification Project

FYI. Frank, I provided you copies of this data this afternoon.

----- Forwarded by Elaine Strzelewicz/Riley/US on 04/24/2001 03:56 PM -----



"Babul Patel" <bpatel@nexant.com> on 04/24/2001 12:47:50 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: Western Kentucky Poultry Litter Biomass Gasification Project

Ellen:

Here are two files - one Excel - contains some Reid plant operating data, and expected gas composition, flow rate, temperature and pressure. The second is a word file that contains site specific information and the Riley Boiler Specifications. Let me know if you will need additional information.

Thanks

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580



- Reid Plant Data.xls



- ReidSite\_data.doc

# CASE I: 8.4 TPH POULTRY LI'

Stream ID				1	2	3
Stream Name				GASIFIER FEED	GASIFIER COMB AIR	GASIFIER BOTTOM ASH
Pressure, "w.c.-g, or (psig)				---	20.0	---
Temperature, °F				77.0	80.0	300.0
Molecular Weight (lb/lbmole)				---	28.7	67.2
Component	Formula	MW		lb/h	lb/h	lb/h
Carbon	C	12.01		4,617.3		466.9
Hydrogen	H	1.01		526.6		
Nitrogen	N	14.01		463.0		
Oxygen	O	16.00		3,416.1		
Sulfur	S	32.06		82.9		
Chlorine	Cl	35.45		-		
Fuel Gas	CH4	16.04				
Carbon Monoxide	CO	28.01				
Carbon Dioxide	CO2	44.01				
Hydrogen	H2	2.02				
Water (v)	H2O (v)	18.02			267.1	
Nitrogen	N2	28.01			20,853.3	
Oxygen	O2	32.00			6,312.8	
Sulfur Dioxide	SO2	64.06				
Hydrogen Chloride	HCl	36.46				
Ash	SiO2	60.08		3,494.0		3,960.9
Lime	CaCO3	100.09				
Water (l)	H2O (l)	18.02		4,200.0		
TOTAL				16,800.0	27,433.2	4,427.8
AVAILABLE ENERGY VALUE (LHV-Hv), Btu/lb				4,051.5		
AVAILABLE ENERGY, MMBtu/h				68.1		-
FLOW RATE, scfm (gpm)					6,049.9	
FLOW RATE, acfm					6,282.6	

ITER

4	8	9	10	11	12	13
GASIFIER SYNGAS	ID FAN EXHAUST	PILOT GAS	OVERFIRE COMB AIR	OVERFIRE SYNGAS	PILOT GAS	REOX COMB AIR
(0.3)	8.0	(30.0)	13.0	7.0	(30.0)	13.0
1,550.0	1,381.8	77.0	80.0	2,400.0		80.0
25.0	24.7	16.0	28.7	27.0	16.0	28.7
lb/h	lb/h	lb/h	lb/h	lb/h	lb/h	lb/h
		23.3			23.3	
3,819.3	3,819.3			633.3		
9,206.7	9,206.7			14,276.2		
421.0	421.0			200.4		
5,411.6	6,575.7		157.0	8,756.2		244.6
21,316.3	21,316.3		12,257.5	33,573.7		19,098.9
			3,710.7			5,781.7
165.7	165.7					
69.9						
40,410.3	41,504.6	23.3	16,125.1	57,439.8	23.3	25,125.3
953.9	928.7	21,502.0		229.0	21,502.0	
38.5	38.5	0.5		13.2	0.5	
10,242.9	10,644.2	9.2	3,556.1	13,478.1	9.2	5,541.0
39,592.7	37,701.1	9.5	3,692.9	74,129.3	8.1	5,754.1

14  
COMB  
PROD TO  
BOILER

6.0  
2,330.2  
28.0  
lb/h

15,335.0

10,843.7  
52,672.6  
3,737.0

82,588.3

18,642.4  
100,030.5

## **WKE Reid Plant Bio Gasification Project**

### **Site Specific Data**

#### **Henderson, KY Area Meteorological Data**

**Latitude: 37:45:00 N, Longitude: 87:30:00 W, Elevation: 387 Ft.**

<b>Element</b>	<b>Annual Mean</b>	<b>Annual Minimum</b>	<b>Annual Maximum</b>	<b>Units</b>
Avg. Temperature	56.9	-20.	113.	Deg F
Avg. Ambient Pressure				IN Hg
Avg. Relative Humidity	72	55		% RH
Avg. Wind Speed	70 <sup>1</sup>		74 <sup>2</sup>	MPH (UBC)
Annual Precipitation	44.8	28.25	71.01	IN
Maximum One Day			6.33	IN
Annual Snow Fall	16.1			IN
Maximum One Day			39.5	IN
Seismic Zone	1 <sup>3</sup>			UBC -1997

Ref: National Climatic Data Center

1. Per Uniform Building Code mean design wind speed.

2. From NOAA wind gust over 5 seconds (1930-1996 data).

3. A micro earthquake occurred at 3:04:26 AM (CDT) on Saturday, August 26, 2000.

The magnitude 2.5 event occurred 28 km (18 miles) ENE (61 degrees) of 20 Evansville.

The hypocentral depth is 5 km (3 miles). (Ref. – USGS website)

Indiana-Illinois-Kentucky border point is classified as Seismic Zone 2A. (UBC – 1997 Fig. 16-2)



## ***WKE Reid Plant Bio Gasification Project***

---

### **Site Specific Data**

#### **Boiler Specifications:**

##### **REID PLANT**

Location Henderson, KY

WKE Contract B2502

##### **GENERAL INFORMATION**

RILEY Boiler Contract No.

B2502

RILEY Boiler Serial No.

3456

Year Built

1964

RILEY Fuel Burning Contract No.

TM6833.

Engineers Burns and McDonnell Co., Kansas City, MO

Maximum Continuous Capacity

690,000 lbs. Steam /hr

Peak capacity

760,9000 lbs. Steam/hr.

Type of Furnace Operation -

Pressurized

Drum Design Pressure

1475 psig

Economizer design Pressure

1525 psig.

Operating Pressure at Superheater Outlet

1300 psig

Steam, Temperature at Superheater Outlet

955°F

Furnace Volume

50,250 cu. ft.

Heat Release

16,600 Btu/cu. ft./hr.

(At 690,000-lbs./hr. capacity when burning coal.)

Heat Release

19,400 Btu/cu. ft./hr.

(At 760,000-lbs./hr. capacity for four hrs )

Heating Surfaces (Per Manufacturer's Stamping Sheet)

Boiler

4,020 sq. ft.

Water Walls

12,100 sq. ft.

Superheater

32,330 sq. ft.

Economizer

4,200 sq. ft.

Air Heater

82,400 sq. ft.

Approximate Water Capacity to Normal Water Level 500,788 lbs. ~62,599 gals

Approximate Water Capacity for Hydrostatic Test 827,253 lbs. ~103,407 gals

**RILEY Stoker Corporation**

WORCESTER, MASSACHUSETTS

# WKE Reid Plant Bio Gasification Project

## Site Specific Data

### Reid Plant Coal Analysis

Coal	Average	Minimum	Maximum	Units	Source
As Burned Coal (LHV)	11,986	11,422	12,296	Btu/lb.	Reid Plant Data (Y 2000) ▼
Moisture	8.6	7.5	10.8	%	
Ash	10.6	8.6	12.2	%	
S	2.6	2.3	2.8	%	

### Poultry Litter Analysis

Poultry Litter	Average	Minimum	Maximum	Units	Source
Sample #					Date:
LHV				Btu/lb.	
Moisture				%	
Ash				%	
Volatile				%	
fixed Carbon				%	
Sulfur				%	
Hydrogen				%	
Nitrogen				%	
Chlorine				%	
Phosphorus (P)				%	
Potassium (K)				%	
Sodium (Na)				%	

### Reid Plant Environmental Emission Limit

Pollutant	PPM	lbs./MBtu	Tones/Quarter	Tones/Year
CO				
NOx				
SOx				
Particulates				
Metals				
Hg				
Heat Input (MBtu/hr)				

ELAINE  
STRZELEWICZ  
05/03/2001 08:30 AM



To: Frank Zone/Riley/US@Riley, Richard Dube/Riley/US@Riley  
cc: Enrique Vega/Riley/US@Riley  
Subject: WKE - Poultry Litter

Frank, based on our conversation with Babul, please see the following.

----- Forwarded by Elaine Strzelewicz/Riley/US on 05/03/2001 08:20 AM -----



"Babul Patel" <bpatel@nexant.com> on 05/02/2001 07:20:14 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: WKE - Poultry Litter

After our phone conversation, I talked to our experts and gasifier vendor. The reason for over fire burner in the gasifier design is to handle NOx.

Unfortunately, poultry litter contains considerable bound nitrogen, which comes out of the gasifier as ammonia, methyl amine, NOx, etc. The gasification temperature is not sufficient to reduce these bound nitrogen compounds to N2. If oxidized directly, as it would be in the boiler, a large portion of these will convert to NOx. The result will be very high NOx emissions.


By utilizing the over fire, we provide a high temperature, reducing atmosphere, which reduces these bound nitrogen compounds to N2. This was the basis for our design. We are looking into cooling the gas before ID fan, but the over fire burner will be after ID fan. The ReOX burner can be eliminated. I am attaching the PFD that was basis for our Material and Energy Balance.

Please pass this information to Frank and Dick Doubey. Give me a call if you think this will be a problem.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580



- PFD.doc

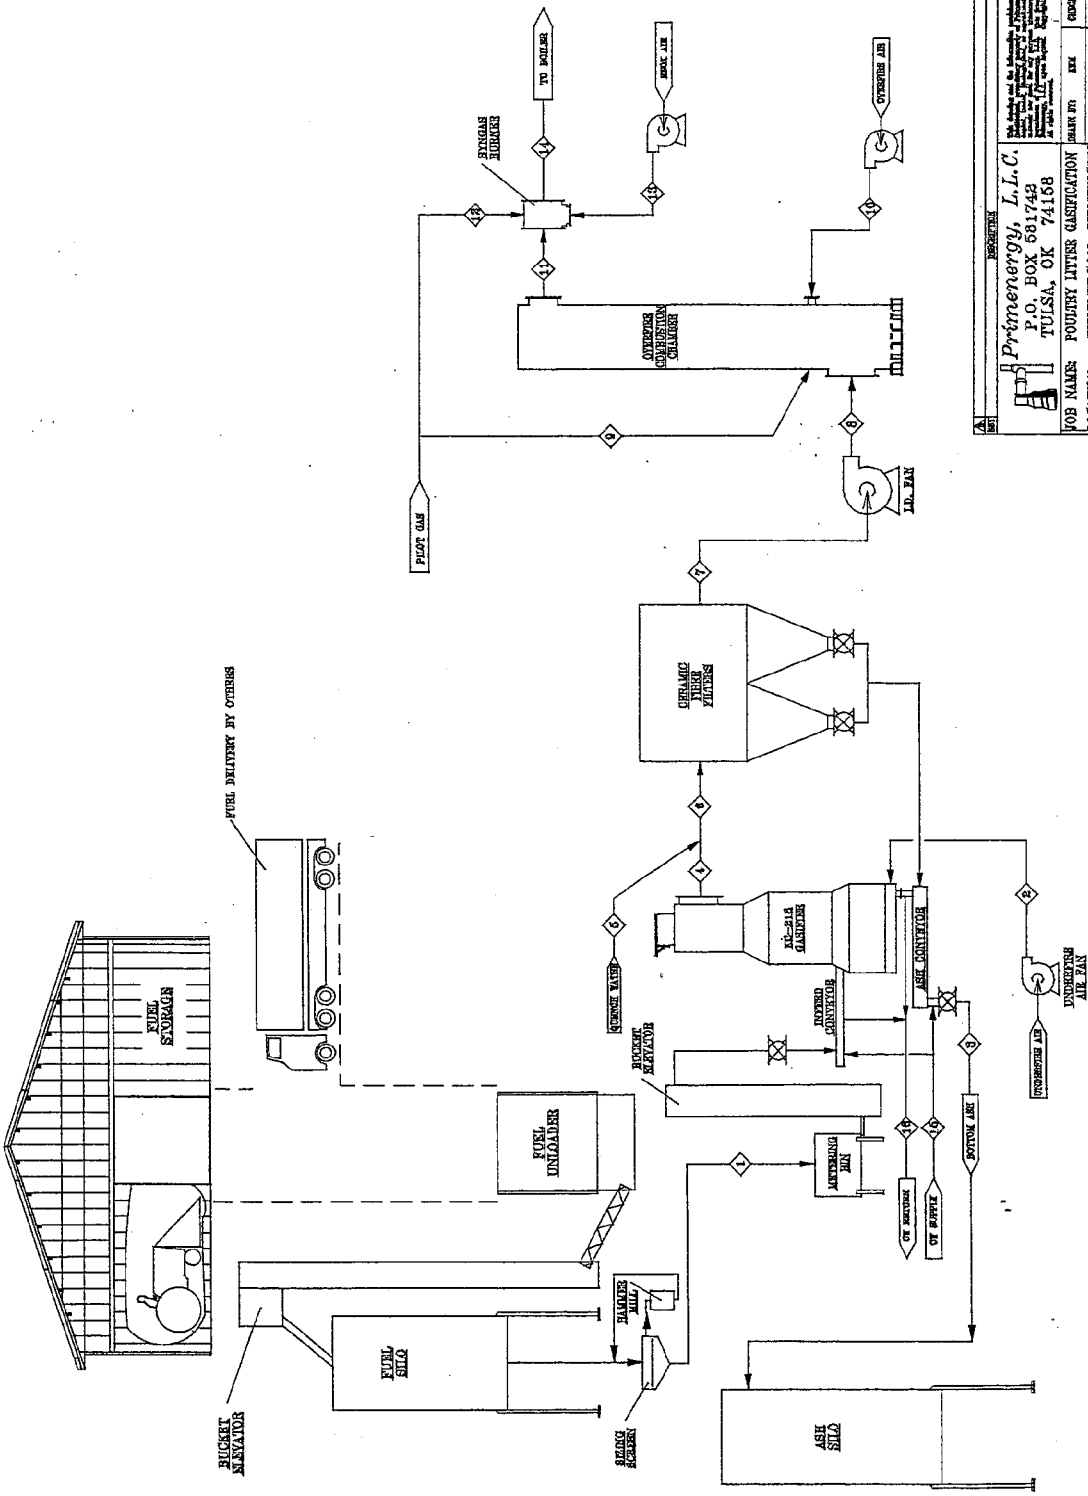

PRIMEENERGY, L.L.C.		P.O. BOX 681743		TULSA, OK 74168	
JOB NAME: POULTRY LITTER GASIFICATION		LOCATION: HENDERSON, KENTUCKY		CONTRACTOR: NEXANT	
END USER: YEE		DATE: 01/14/01		DATE APPROVED:	
DESCRIPTION: PROCESS FLOW DIAGRAM		0149		00	
001		E		E	

ELAINE  
STRZELEWICZ  
05/16/2001 11:23 AM



To: bpatel@nexant.com  
cc: Frank Zone/Riley/US@Riley, Richard Dube/Riley/US@Riley  
Subject: FW: Boiler Entry

BAbul, Frank needs thermal conductivity values of insulation and refractory for the pipe inside lining in order to perform his calculation.

----- Forwarded by Elaine Strzelewicz/Riley/US on 05/16/2001 11:19 AM -----



"Babul Patel" <bpatel@nexant.com> on 05/15/2001 07:32:49 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: FW: Boiler Entry

Ellen:

I had discussion with Frank and Dick about the boiler penetrations. I passed their questions and concerns to Primenergy, and I got following response. I have also left messages with refractory engineer from the past to seek his advise.

I am checking Kevin's' calculations, but 4 ~38" penetrations along the side of the boiler do not look out of the ordinary. The overfire chamber is a refractory lined vessel with approx. 6' ID that will be sitting on the ground approximately 15' from the boiler house. We will have to figure out how to route 4 large pipes from there into the boiler. Ideally, we would like to have the cooled gas at 1000 deg F going into the boiler, but due to NOx issue, we have to burn the gas outside.

Hope, this helps. If Frank and Dick have questions, please call.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580

-----Original Message-----

From: Kevin McQuigg [mailto:kmcquigg@primenergy.com]  
Sent: Tuesday, May 15, 2001 12:57 PM  
To: Babul Patel (E-mail)  
Cc: W.N. (Bill) Scott  
Subject: Boiler Entry

Babul,

I am presently working on the calculations, including the flue gas to air heat exchanger downstream of the hot gas filters. As it turns out, the air preheat makes only a small difference on the gas flows.

I need to check my calculations, but I am presently showing the following for the syngas leaving the overfire:

Flow rate 2,047.2 lbmole/hr (1,187 acfs)  
Temperature 2400°F  
Mole weight 27.0

Composition  
Component Vol%

CO	1.02
CO2	15.18
H2	4.59
H2O	23.26
N2	55.83
SO2	0.12

If we want 4 entry points at 150 fps, they would be 19" ID.

We would line the boiler entry pipe (duct) with 4" of hot face refractory (i.e. Thermal Ceramics Kaogun 32) and 5" of insulating refractory. Assuming 3/8" shell, the OD will be just under 38". This refractory lining will provide a 230°F shell temperature. To achieve an OSHA surface temperature, we can either use heat shielding or rainshield with an air gap. It makes no sense to externally insulate refractory lined surfaces.

I don't see why this is any different than a burner entry into the boiler. It will require some refractory lining inside the boiler, say about 6" around the injector opening.

Kevin

ELAINE  
STRZELEWICZ  
05/17/2001 11:50 AM



To: Richard Dube/Riley/US@Riley, Frank Zone/Riley/US@Riley  
cc: Enrique Vega/Riley/US@Riley  
Subject: FW: Boiler Penetration  
Job 200756

Frank, here's some information for you from Babul. So, is the OD 6' or 38" - have we verified numbers yet? Also, here are the hours used through May 13th - Frank - 59 hours; Dick 14.5 hours

----- Forwarded by Elaine Strzelewicz/Riley/US on 05/17/2001 11:39 AM -----



"Babul Patel" <bpatel@nexant.com> on 05/16/2001 08:50:27 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: FW: Boiler Penetration

Here is info from Kevin. I looked up values for Kaolite-- It is listed at  
1000 Deg - 1.32 Btu-In/hr Ft2/Deg F

2000 Deg

1.79 and Mean at 500 deg F as 1.13 Btu-in/hr ft2/deg F.

Kaogun seems specialty casting, and I will have to get its value from Kevin.  
Bechtel's experience with kaolite lined piping is acceptable.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580

> -----Original Message-----  
> From: Kevin McQuigg [mailto:kmcquigg@primenergy.com]  
> Sent: Wednesday, May 16, 2001 8:54 AM  
> To: 'Babul Patel'  
> Subject: RE: Boiler Penetration  
>  
> Babul,  
>  
> I used Thermal Ceramics heat transfer program "HEAT FLOW" to calculate the  
> outside shell temperature. I trust this program is accurate, since we  
> (Primenergy, HSI, John Zink, Callidus, etc.) use it to design our  
> refractory systems.  
>  
> The parameters I used were as follows:  
>  
> 38" diameter horizontal cylinder  
> 2400°F hot face  
> 80°F ambient, 0 mph wind  
> surface has 0.9 emissivity  
>

> With 4" thick Kaogun 30  
> 5" thick Kaolite 23-Li  
> 3/8" carbon steel shell  
>  
> Cold Face temperature is 268°F  
>  
> Actually, the above is conservatively high on the cold face temperature,  
> since the wind velocity will never be zero when there is this much  
> temperature difference between the cold face and ambient. Also, if we use  
> a rainshield (with an air gap and top air dump) for personnel protection,  
> the air intake and dump will create a draft which will reduce the cold  
> face temperature. A 5 mph wind reduces the cold face temp to 220°F.  
>  
> If necessary, I can get the refractory conductivities (they are probably  
> available from Thermal Ceramics' web site), but you also have to include  
> the cold face / ambient convection.  
>  
> Kevin  
>  
>  
>  
> -----Original Message-----  
> From: Babul Patel [mailto:bpatel@nexant.com]  
> Sent: Wednesday, May 16, 2001 12:09 PM  
> To: Kevin McQuigg  
> Subject: Boiler Penetration  
>  
> Kevin:  
>  
> What thermal conductivity value you are using to calculate the refractory  
> thickness? Also, what will be the outside surface temperature of the  
> refractory lined piping?  
>  
>  
> Babul Patel  
> Nexant Inc.  
> bpatel@nexant.com  
> Ph: (415)-768-1200  
> Fax: (415)-768-3580  
>



- winmail.dat



ELAINE  
STRZELEWICZ  
05/17/2001 01:21 PM



To: Frank Zone/Riley/US@Riley, Richard Dube/Riley/US@Riley  
cc: Enrique Vega/Riley/US@Riley  
Subject: FW: boiler penetration

Frank, Dick, additional information from Babul.

----- Forwarded by Elaine Strzelewicz/Riley/US on 05/17/2001 01:18 PM -----



"Babul Patel" <bpatel@nexant.com> on 05/17/2001 12:27:53 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: FW: boiler penetration

Some additional info. I am tied up for today and tomorrow, but if you or Frank and Dick have questions, give me call. I will call you back ASAP if I am not at my desk.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580

-----Original Message-----

From: Kevin McQuigg [mailto:kmcquigg@primenergy.com]  
Sent: Thursday, May 17, 2001 5:35 AM  
To: Babul Patel (E-mail)  
Cc: W.N. (Bill) Scott  
Subject: boiler penetration

Babul,

I reevaluated the refractory lining using RHI's refractory program "HEATransfer". Using 4" of hot face (Kast-O-Lite 30 Li G) and 5" of insulating castable (Kast-O-Lite 22 G). With the same operating assumptions used for the Thermal Ceramics program ---- 3/8" shell, 38" OD, 80°F ambient, 0 wind, 0.9 emissivity, 2400°F hot face. ----- The program predicts a 335° shell temperature. This is a little higher than the Thermal Ceramics prediction, but still acceptable. For sulfur plant applications, I have designed carbon steel shell temperatures as high as 500°F.

To minimize heat loss, we can keep the boiler penetration ducts very short, coming off a main header duct. The main header could include additional refractory to keep its shell temperature lower.

Kevin

ELAINE  
STRZELEWICZ  
05/18/2001 04:24 PM



To: Frank Zone/Riley/US@Riley  
cc: Richard Dube/Riley/US@Riley  
Subject: Boiler Penetration

Frank, Babul has responded regarding that spreadsheet.

----- Forwarded by Elaine Strzelewicz/Riley/US on 05/18/2001 04:21 PM -----



"Babul Patel" <bpatel@nexant.com> on 05/18/2001 04:16:09 PM

To: "Ellen Strzelewicz" <estrzelewicz@bbpwr.com>  
cc:  
Subject: Boiler Penetration

Ellen:

I talked with Kevin. The attachment was something left over from his e-mail, but did not have any useful info in there. The only info I forwarded, is the result of what Jim obtained by running Thermal Ceramics heat transfer program "HEAT FLOW". The program calculates optimum thickness based on flow and Temperature and does not require input of K value! (they must be using the standard configuration). The Kaogun is high alumina based refractory with K value of 7.5 Btu-In/hr Ft<sup>2</sup>/Deg F and Kaolite is value is 1.3 Btu-In/hr Ft<sup>2</sup>/Deg F.

Please let me know if you need more info.

Babul Patel  
Nexant Inc.  
bpatel@nexant.com  
Ph: (415)-768-1200  
Fax: (415)-768-3580



- winmail.dat